Hi electric

QY - Series Miniature Circuit Breakers





Dual mount (black body)

Dual mount + Auxiliary (black body)





Dual mount series (black body)

Features

(grey body)

- DC Circuit Breaker
- Hydraulic-Magnetic technology
- 100% rating capability, independent of ambient temperature
- VDE and CCC approved, CE certified
- UL listed (UL 489 A)
- Ratings 0.1 to 63 A (1 & 2 pole), 3 pole parallel (150 A maximum), 4 pole parallel (200 A maximum)
- Optional Auxiliary Switch / Trip Alarm factory fitted (6.5 mm wide)
- Optional Shunt Trip (no approvals)
- Wide range of time delays and operating currents
- Precision tripping characteristics
- Ultra compact 13 mm wide module
- Trip indication with mid-trip handle
- · Reset immediately after overload
- DIN mount product in grey shells
- Dual mount product in black shells
- 80 V DC devices are reverse feedable
- I25 / 250 / 600 V DC devices are polarity sensitive
- Suitable to use for electrical isolation

Auxiliary Switch, Trip Alarm & Combo: Features

- AC and DC voltages
- UL 489 listed (Auxiliary Switch: 6 A 250 V AC, 0.5 A 80 V DC)
- IEC 60947-5-1 approved (Auxiliary Switch: 6 A 240 V AC, 0.5 A 110 V DC; Trip Alarm: 6 A 240 V AC, 0.5 A 110 V DC)
- Factory fitted
- · Attached to right hand side of Circuit Breaker
- Compact 6.5 mm width

Applications

- DC branch circuit protection (UL 489A, IEC / EN 60947-2)
- Telecom / datacom equipment
- UPS equipment
- Alternative energy equipment
- Battery protection & switching
- Telecommunication DC power distribution
- Railway signalling equipment

Optional Accessories

- Auxiliary Switch (DIN and Dual Mount)
- Auxiliary Switch + Trip Alarm (Dual Mount only)
- Trip Alarm (Dual Mount only)
- Handle lock
- Surface mounting clips
- Busbar
- 57 mm Escutcheon blank (Dual Mount only)
- 57 mm Safety blank (Dual Mount only)

QY-SERIES-DAT APR 2015



Technical Data

Approvals	IEC / EN 60947-2, VDE										
Number of Poles	I	2	2 parallel	2 parallel	parallel 3 parallel		2 series	l pole plug-in			
Operating Voltages	80 V DC,	80 V DC, 125 V DC 80 V DC		125 V DC	80 V DC		250 V DC	80 V DC			
Minimum Current Rating	0.1 A	0.1 A	60 A	30 A	110 A	200 A	0.1 A	0.1 A			
Maximum Current Rating	63 A	50 A	100 A	100 A	150 A	200 A	50 A	50 A			
Interrupting Capacity	I0 kA										
Operating Temperature Range	-40°C to +85°C										
Mounting Options	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal										
Time Delay Curves	I, 9, U2, U3, OP										

Approvals	UL 489A									
Number of Poles	I	2	2 parallel	2 parallel	3 parallel	4 parallel	2 series	4 series	l pole plug-in	
Operating Voltages	80 V DC,	125 V DC	80 V DC	125 V DC	80 / 125 V DC	80 V DC	250 V DC	600 V DC	80 V DC	
Minimum Current Rating	0.1 A	0.I A	30 A	20 A	110 A	200 A	0.1 A	0.1 A	0.I A	
Maximum Current Rating	63 A	50 A	100 A	100 A	150 A	200 A	50 A	20 A	50 A	
Interrupting Capacity					10 kA					
Operating Temperature Range	-40°C to +85°C									
Mounting Options	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal									
Time Delay Curves		I, 9, U2, U3, OP								

Approvals	ССС								
Number of Poles	I	2	2 parallel	3 parallel	4 parallel	I pole plug-in			
Operating Voltages	80 V DC								
Minimum Current Rating	0.1 A	0.1 A	30 A	110 A	200 A	0.1 A			
Maximum Current Rating	63 A	50 A	100 A	150 A	200 A	50 A			
Interrupting Capacity	10 kA								
Operating Temperature Range	-40°C to +85°C								
Mounting Options	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal								
Time Delay Curves	I, 9, U2, U3, OP								

Breaker QY	Wire Size mm ² (IEC)	Wire Gauge (UL)	Torque (IEC)	Torque (UL)	Comments
I Pole & 2 Pole	0.75 - 35 mm²	18-2-AWG	2.5 Nm	20 in-lb	Pozidriv #2 Combi head
2 Pole Parallel	50 mm ²	14 – 1/0 – AWG	3.2 Nm	28 in-lb	Bridge Terminal
3 Pole Parallel	95 mm ²	14 – 5/0 – AWG	5.6 Nm	50 in-lb	Bridge Terminal
4 Pole Parallel	95 mm ²	14 – 5/0 – AWG	5.6 Nm	50 in-lb	Bridge Terminal

Helectric

low voltage

QY - Series Miniature Circuit Breakers

Long Code

Example Code: QY---A-3(13)-D-U2-150A-B0----Z

Group		2	3	4	5	4-3(13)-D	7	8	9	10	11	2		
Group	-											Parallel		
Requirement	QY Frame	Switch / Neutral	Auxiliary	Triple pole	13 mm module width	DIN Rail	Mediur delay curve U	Rating	Voltage 80 V DC	No Shunt Trip	Future use	bridged (by customer)		
Long Code	QY	-	Α	3	(13)	D	U2	150A	B0	-	-	Z		
Group I:	Code			Descriptio	on				Co	mments				
Frame Type	QY		13 mm wide	e Miniature (Circuit Break	er		UL 48	9A, IEC / EN	I 60947-2,VE	DE, CE, CCC	2		
Group 2:	Code			Descriptio	on				Co	mments				
Switch/Neutral	-			Not applicat	ble			Overloa	d poles do r	ot have any	further cod	ing		
Group 3: Auxiliary	Code			Descriptio				Comments						
Auxiliary	-			Not applical				Use this code if no Auxiliary used						
	A		Auxiliary Sw			,	(6.5 mm module				,		
	T		Trip Alarm (,	<u> </u>	6.5 mm modul		<u> </u>		.,		
Group A:	AT	Auxiliary S	witch + Trip			i în l module	2)	6.5 mm modul		•	e (Dual Mo	unt only)		
Group 4: No of Poles	Code			Descriptio					Co	mments				
	2			Single pole										
	3		Double pole Triple pole											
	4			Four pole										
Group 5:	Code			Descriptio					Co	mments				
Module Width	(13)		13	mm module				13 mm per pole						
Group 6:	Code			Descriptio	on			Comments						
Mounting	D	DIN	l rail mount -	– 45 mm Esc	utcheon, gre	y body		DIN mount supplied in grey only						
	DM	Du	ial mount – 5	57 mm Escut	cheon, black	body		Dual mount supplied in black only						
Group 7:	Code			Descriptio	on		In	Instantaneous Trip Point (x In) Comments						
Time Delays	I		Long time d	elay, high inst	tantaneous t	rip		I0 – 20 Orange handle						
	9			Long time de	,			7 – 12 White har						
	U2			edium time	,			5 – 10 White handle						
	U3			Short time d	,			3 – 5 White handle						
Group 8:	OP	_	Cada	Instantaneo		_		None White handle Comments						
Current			Code /	Descriptio	on			Ratings available vary depending on certification, bridging						
Ratings	0.1,0.2	, 0.3, 0.5, 1, 2, 3 50, 60,	3, 4, 5, 6, 7, 8 63, 70, 80, 90					configuration and voltage. (See comments in Group 9) * Other ratings are available as special orders. Check availability.						
Group 9:	Code	Voltage		Des	scription			Comments						
Voltage	B0	80 V DC		Not pol	arity sensitiv	'e	0	0.1 - 63 A I pole, 0.1 - 50 A 2 pole, 60 - 100 A 2 pole par (80 V DC), 30 - 100 A 2 pole parallel (125 V DC),						
(see diagram on page 7)	BI	125 V DC		olarity sensit			110 - 150 A 3 pole parallel, 200 A 4 pole paral (ratings available vary depending on certificatio					ion)		
	B2	250 V DC			pole I bott	om	0.1 - 50 A 2 pole series bridged at the top (by cus pole 1 (-) to pole 2 (+)					,		
	B3	250 V DC			pole I bott	om		0.1 - 50 A 2 pole series bridged at the top (factory fitted) pole I (-) to pole 2 (+)						
	B4	600 V DC	4 p	oles in serie Positive =	s bridged (4 pole 1 bott	,		0.1 - 20 A 4 pole series bridged (factory fitted) As per wiring diagram printed on unit						
	ті	I25 V DC Polarity sensitive. Positive top.						0.1 - 63 A I pole, 0.1 - 50 A 2 pole, 30 - 100 A 2 pole parallel, 110 - 150 A 3 pole parallel, 200 A 4 pole parallel						
	Т2	250 V DC	250 V DC 2 poles in series bridged (2 x 125 V) Positive = pole 1 top						0.1 - 50 A 2 pole series bridged at the bottom (by customer) pole 1 (-) to pole 2 (+)					
	Т3	250 V DC			= pole I to	P		0.1 - 50 A 2 pole series bridged at the bottom (factory fitted) pole 1 (-) to pole 2 (+)						
	T4	600 V DC 4 poles in series bridged (4 x 125 V) Positive = pole 1 top								ries bridged (iagram printe		ed)		

Continues on page 4

QY-SERIES-DAT APR 2015

Data Sheet Page 3 of 8





Long Code continues

Group 10:	Code	Description	Comments						
Shunt Trip	-	Not applicable	Use this code if no Shunt Trip is used						
(not certified,	V0	100 – 480 V	Fly leads (approximately 60 mm long)						
only offered as	V5	100 – 480 V	Internally connected						
special order)		Other voltages are availa	ailable as special orders. Check availability.						
Group II	Code	For future use (-)							
Group 12:	Code	Description	Comments						
Special Termination	-	Not applicable	Use this code if no special terminations are used						
Termination	Р	Plug-in							
	Z	Bridged unit (bridge to be fitted by customer)							
	ZL	Bridged unit (factory fitted)							

For options not listed, please contact CBI for assistance

Time Delay Curves

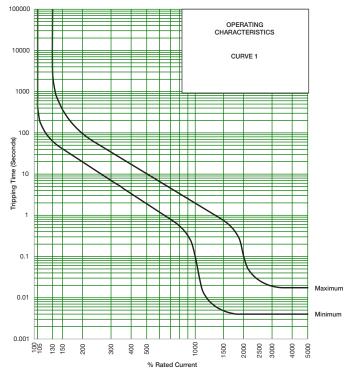

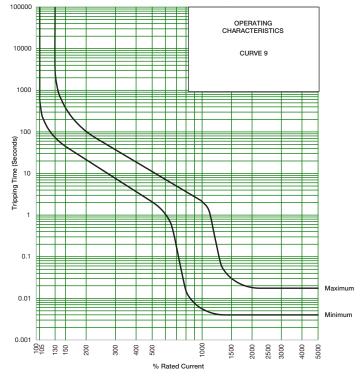


QY-SERIES-DAT APR 2015

Hi electric Iow voltage

QY - Series Miniature Circuit Breakers


Time Delay Curves

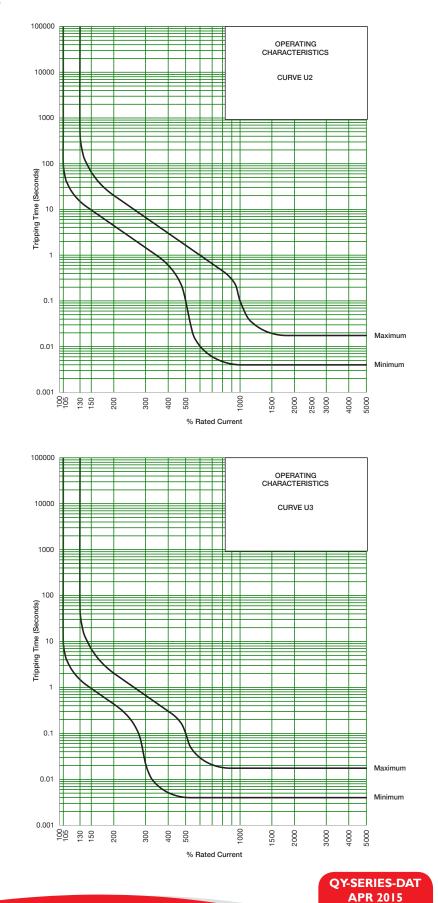

Data Sheet Page 5 of 8



Time Delay Curves

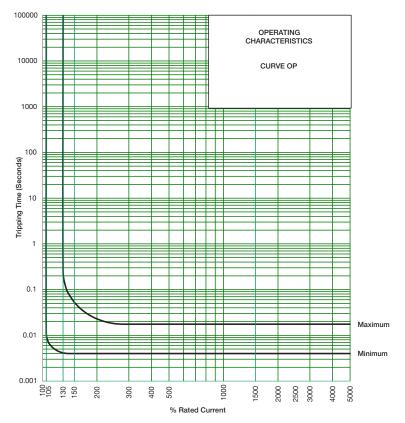

* The published time delay curves are generated at 30°C ambient temperature with the Circuit Breaker mounted in the up-right position. The "must hold", "must trip" and "instantaneous trip" current values are not affected by temperature, although delay time for the other operating current values may have to be adjusted using the temperature compensation curve which is available on request.


Internal Resistance vs Current Rating



Typical outline of Auxiliary Switch / Trip Alarm

Auxiliary available (6.5 mm module width) to match the unit to which it is attached. Available types as listed in Group 3:

- Type T Trip Alarm as shown in outline drawings (fitted on a Dual mount product)
- Type AT Auxiliary Switch + Trip Alarm (as shown)
- Type A Auxiliary Switch

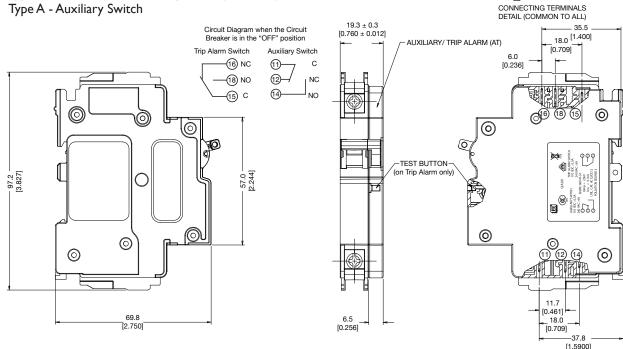

(H) electric

_ Ø 1.4

020

0.5

[Ø₁0.055]

ŝ

0.8

[0.0315]

2.80

[0.110]

2.3 [0.090]

0.0

Typical outline for an Auxiliary module attached to a Dual mount single pole


Tolerance + 0.2 unless otherwise specified

All dimensions in mm [inch]

Circuit Breaker


Polarity identification

Diagram identifying the polarity of 125 V DC products in reference to Group 9 on page 3. Devices are shown viewed from the front. Series devices (standard) - each pole is opposite polarity from the next pole on the left (bridged "-" to "+"). Parallel devices - each pole has the same polarity (bridged "+" to "+", "-" to "-").

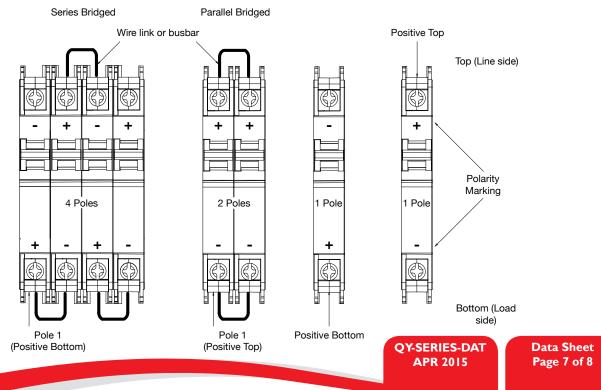




Outline Dimensions: Dual mount

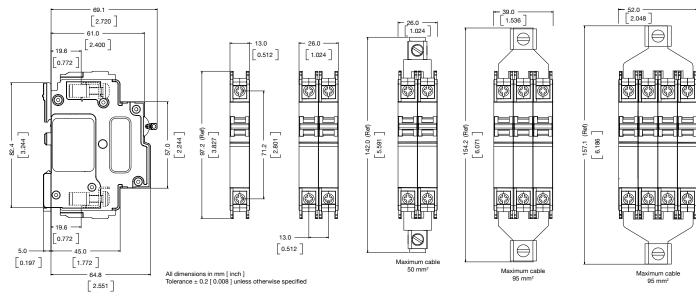

Outline Dimensions: DIN mount

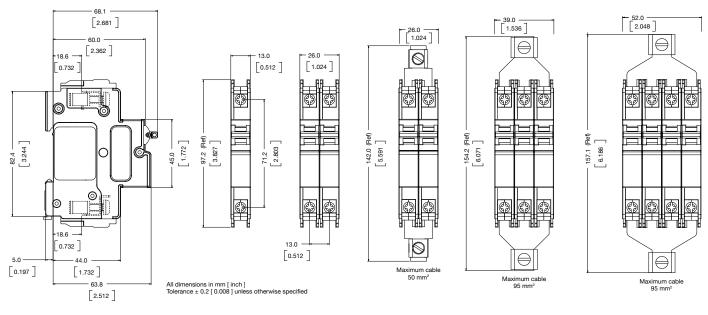

Plug-in terminal dimensions available on request

Please review our Customer Terms and Conditions on www.cbi-lowvoltage.co.za

All rights reserved. Unless otherwise indicated, all materials on these pages are copyrighted by CBI (Pty) Ltd. No part of these pages, either text or image may be used for any purpose other than personal use. Therefore, reproduction, modification, storage in a retrieval system or retransmission, in any form or by any means, electronic, mechanical or otherwise, for reasons other than personal use, is strictly prohibited without prior written permission. CBI (Pty) Ltd reserves the right to alter any details of this document without notice and while every effort is made to ensure the accuracy of the content, no warranty is given as to accuracy of this document and no responsibility will be accepted for error or misinterpretation and any resulting loss.

AUSTRALIA

CBI-electric: Australia 90 Fairbank Road Clayton South Melbourne Victoria 3169 Australia Tel: +61 3 9590 3500 Fax: +61 3 9551 1051 Email: <u>sales@cbi-electric.com.au</u> Website: <u>www.cbi-electric.com.au</u>

SOUTH AFRICA

CBI-electric: low voltage Tripswitch Drive Elandsfontein Gauteng 1401 South Africa Tel: +27 11 928 2000 Fax: + 27 11 392 2354 Email: cbi@cbi-electric.com Website: www.cbi-lowvoltage.co.za

USA

CBI-electric: North America 35 E. Uwchlan Ave Suite 328 Exton PA 19341 USA Tel: +1 610 524 9949 Fax: +1 610 524 9945 E-mail: info@cbibreakers.com Website: www.cbibreakers.com

Data Sheet Page 8 of 8

QY-SERIES-DAT APR 2015

A member of the REUNERT Group